


Project: _____
 Architect: _____
 Contractor: _____
 Supplier: _____

Dealer: _____
 Engineer: _____
 Location: _____
 Date: _____

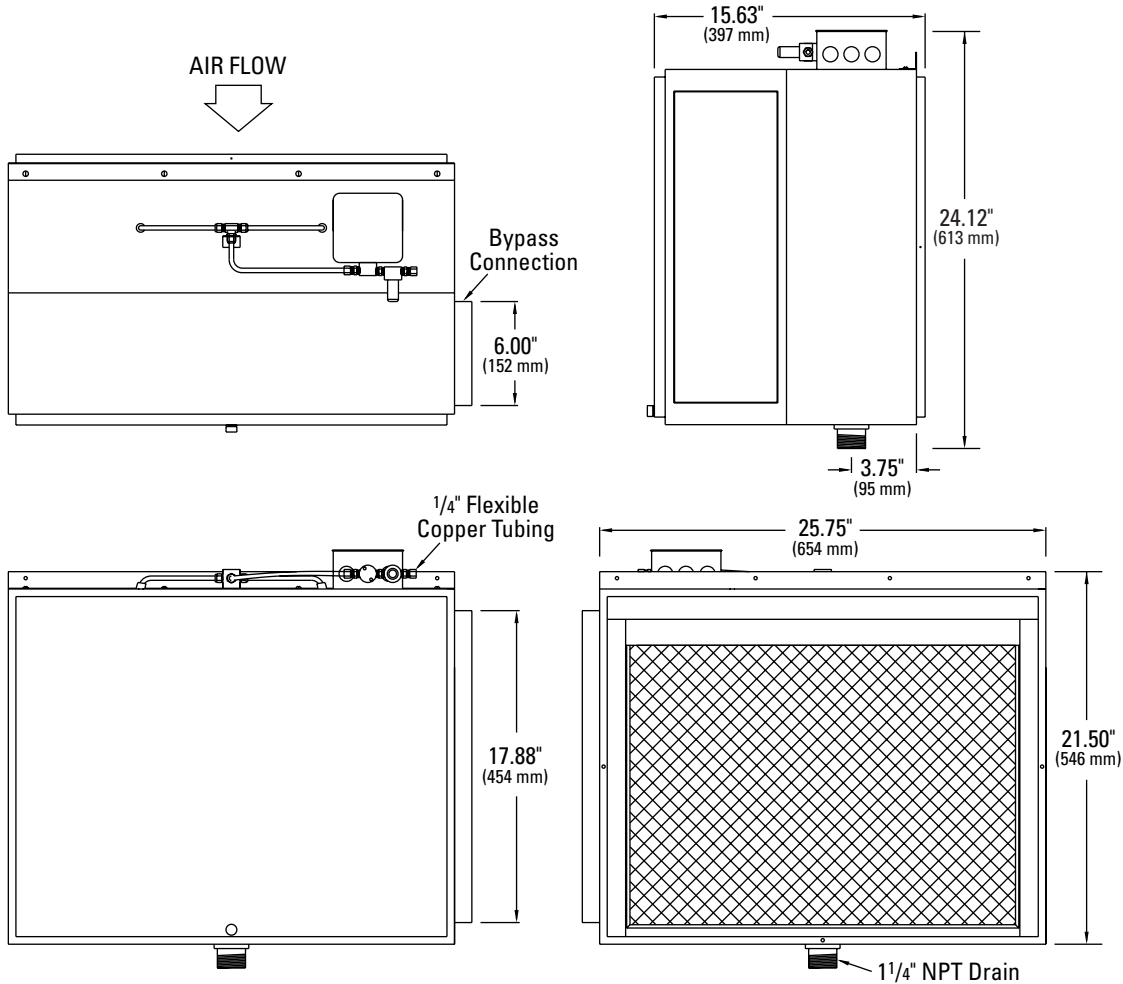

MOUNTING HARDWARE BY OTHERS

| | |
|---|-------------------------------|
| Evaporative Capacity: | 30 lbs/hr |
| Water Feed Rate: | 25 gph |
| Required Water Temperature: | Cold |
| Required Air Temperature in Bypass: | 120 degrees F |
| Ambient Temperature Operating Range: | 60 degrees F to 120 degrees F |
| Minimum CFM Required: | 3,200 CFM |
| Minimum CFM in Bypass: | 800 CFM |

| | |
|------------------------------------|---------------|
| Electrical Characteristics: | |
| • Water Solenoid Valve: | 24 VAC |
| • Control Voltage: | 24 VAC |
| Cabinet Construction: | 18GA Steel |
| Cabinet Finish: | Almond Enamel |
| Shipping Weight: | 50 lbs |

The submittal is intended to show general, overall product dimensions and provide guidance for installation clearance. Drawings are not to scale. Ensure submittals are current. Research Products reserves the right to make product changes without notification or obligation.